

Part III—Building Planning and Construction

CHAPTER 3 BUILDING PLANNING

User note:

About this chapter: Chapter 3 contains a wide array of building planning requirements that are critical to designing a safe and usable building. This includes, but is not limited to, requirements related to general structural design, fire-resistant construction, light, ventilation, sanitation, plumbing fixture clearances, minimum room area and ceiling height, safety glazing, means of egress, automatic fire sprinkler systems, smoke and carbon monoxide alarm systems, accessibility, solar energy systems, swimming pools, spas and hot tubs.

SECTION R301 DESIGN CRITERIA

R301.1 Application. Buildings and structures, and parts thereof, shall be constructed to safely support all loads, including dead loads, *live loads*, roof loads, flood loads, snow loads, wind loads and seismic loads as prescribed by this code. The construction of buildings and structures in accordance with the provisions of this code shall result in a system that provides a complete load path that meets the requirements for the transfer of loads from their point of origin through the load-resisting elements to the foundation. Buildings and structures constructed as prescribed by this code are deemed to comply with the requirements of this section.

R301.1.1 Alternative provisions. As an alternative to the requirements in Section R301.1, the following standards are permitted subject to the limitations of this code and the limitations therein. Where engineered design is used in conjunction with these standards, the design shall comply with the *International Building Code*.

1. AWC *Wood Frame Construction Manual* (WFCM).
2. *AISI Standard for Cold-Formed Steel Framing—Prescriptive Method for One- and Two-Family Dwellings* (AISI S230).
3. *ICC Standard on the Design and Construction of Log Structures* (ICC 400).

R301.1.2 Construction systems. The requirements of this code are based on platform and balloon-frame construction for light-frame buildings. The requirements for concrete and masonry buildings are based on a balloon framing system. Other framing systems must have equivalent detailing to ensure force transfer, continuity and compatible deformations.

R301.1.3 Engineered design. Where a building of otherwise conventional construction contains structural elements exceeding the limits of Section R301 or otherwise not conforming to this code, these elements shall be designed in accordance with accepted engineering practice. The extent of such design need only demonstrate

compliance of nonconventional elements with other applicable provisions and shall be compatible with the performance of the conventional framed system. Engineered design in accordance with the *International Building Code* is permitted for buildings and structures, and parts thereof, included in the scope of this code.

R301.1.4 Intermodal shipping containers. Intermodal shipping containers that are repurposed for use as buildings or structures shall be designed in accordance with the structural provisions in Section 3115 of the *International Building Code*.

R301.2 Climatic and geographic design criteria. Buildings shall be constructed in accordance with the provisions of this code as limited by the provisions of this section. Additional criteria shall be established by the local *jurisdiction* and set forth in Table R301.2.

R301.2.1 Wind design criteria. Buildings and portions thereof shall be constructed in accordance with the wind provisions of this code using the ultimate design wind speed in Table R301.2 as determined from Figure R301.2(2). The structural provisions of this code for wind loads are not permitted where wind design is required as specified in Section R301.2.1.1. Where different construction methods and structural materials are used for various portions of a building, the applicable requirements of this section for each portion shall apply. Where not otherwise specified, the wind loads listed in Table R301.2.1(1) adjusted for height and exposure using Table R301.2.1(2) shall be used to determine design load performance requirements for wall coverings, curtain walls, roof coverings, exterior windows, skylights, garage doors and exterior doors. Asphalt shingles shall be designed for wind speeds in accordance with Section R905.2.4. *Metal roof shingles* shall be designed for wind speeds in accordance with Section R905.4.4. A continuous load path shall be provided to transmit the applicable uplift forces in Section R802.11 from the *roof assembly* to the foundation. Where ultimate design wind speeds in Figure R301.2(2) are less than the lowest wind speed indicated in the prescriptive provisions of this code, the lowest wind speed indicated in the prescriptive provisions of this code shall be used.

R301.2.1.1 Wind limitations and wind design required. The wind provisions of this code shall not apply to the design of buildings where wind design is required in accordance with Figure R301.2.1.1, or where the ultimate design wind speed, V_{ult} , in Figure R301.2(2) equals or exceeds 140 miles per hour (225 kph) in a special wind region.

Exceptions:

1. For concrete construction, the wind provisions of this code shall apply in accordance with the limitations of Sections R404 and R608.
2. For structural insulated panels, the wind provisions of this code shall apply in accordance with the limitations of Section R610.
3. For cold-formed steel *light-frame construction*, the wind provisions of this code shall apply in accordance with the limitations of Sections R505, R603 and R804.

In regions where wind design is required in accordance with Figure R301.2.1.1 or where the ultimate design wind speed, V_{ult} , in Figure R301.2(2) equals or exceeds 140 miles per hour (225 kph) in a special wind region, the design of buildings for wind loads shall be in accordance with one or more of the following methods:

1. *AWC Wood Frame Construction Manual (WFCM)*.
2. *ICC Standard for Residential Construction in High-Wind Regions (ICC 600)*.
3. *ASCE Minimum Design Loads for Buildings and Other Structures (ASCE 7)*.
4. *AISI Standard for Cold-Formed Steel Framing—Prescriptive Method for One- and Two-Family Dwellings (AISI S230)*.
5. *International Building Code*.

The elements of design not addressed by the methods in Items 1 through 5 shall be in accordance with the provisions of this code.

Where ASCE 7 or the *International Building Code* is used for the design of the building, the wind speed map and exposure category requirements as specified in ASCE 7 and the *International Building Code* shall be used.

R301.2.1.1.1 Sunrooms. *Sunrooms* shall comply with AAMA/NPEA/NSA 2100. For the purpose of applying the criteria of AAMA/NPEA/NSA 2100 based on the intended use, *sunrooms* shall be identified as one of the following categories by the permit applicant, *design professional* or the property owner or owner's agent in the *construction documents*. Component and cladding pressures shall be used for the design of elements that do not qualify as main windforce-resisting systems. Main windforce-resisting system pressures shall be used for the design of elements assigned to provide support and stability for the overall *sunroom*.

Category I: A thermally isolated *sunroom* with walls that are open or enclosed with insect

screening or 0.5 mm (20 mil) maximum thickness plastic film. The space is nonhabitable and unconditioned.

Category II: A thermally isolated *sunroom* with enclosed walls. The openings are enclosed with translucent or transparent plastic or glass. The space is nonhabitable and unconditioned.

Category III: A thermally isolated *sunroom* with enclosed walls. The openings are enclosed with translucent or transparent plastic or glass. The *sunroom* fenestration complies with additional requirements for air infiltration resistance and water penetration resistance. The space is nonhabitable and unconditioned.

Category IV: A thermally isolated *sunroom* with enclosed walls. The *sunroom* is designed to be heated or cooled by a separate temperature control or system and is thermally isolated from the primary structure. The *sunroom* fenestration complies with additional requirements for water penetration resistance, air infiltration resistance and thermal performance. The space is nonhabitable and conditioned.

Category V: A *sunroom* with enclosed walls. The *sunroom* is designed to be heated or cooled and is open to the main structure. The *sunroom* fenestration complies with additional requirements for water penetration resistance, air infiltration resistance and thermal performance. The space is habitable and conditioned.

R301.2.1.2 Protection of openings. Exterior glazing in buildings located in *windborne debris regions* shall be protected from windborne debris. Glazed opening protection for windborne debris shall meet the requirements of the Large Missile Test of ASTM E1886 and ASTM E1996 as modified in Section 301.2.1.2.1. Garage door glazed opening protection for windborne debris shall meet the requirements of an *approved* impact-resisting standard or ANSI/DASMA 115.


Exception: *Wood structural panels* with a thickness of not less than $\frac{7}{16}$ inch (11 mm) and a span of not more than 8 feet (2438 mm) shall be permitted for opening protection. Panels shall be precut and attached to the framing surrounding the opening containing the product with the glazed opening. Panels shall be predrilled as required for the anchorage method and shall be secured with the attachment hardware provided. Attachments shall be designed to resist the component and cladding loads determined in accordance with either Table R301.2.1(1) or ASCE 7, with the permanent corrosion-resistant attachment hardware provided and anchors permanently installed on the building. Attachment in accordance with Table R301.2.1.2 is permitted for buildings with a mean roof height of 45 feet (13 728 mm) or less where the ultimate design wind speed, V_{ult} , is 180 mph (290 kph) or less.

**TABLE R301.2
CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA**

GROUND SNOW LOAD ^o	WIND DESIGN			SEISMIC DESIGN CATEGORY ^y	SUBJECT TO DAMAGE FROM		ICE BARRIER UNDERLAYMENT REQUIRED ^h	FLOOD HAZARDS ^g	AIR FREEZING INDEX ⁱ	MEAN ANNUAL TEMP ⁱ
	Speed ^d (mph)	Topographic effects ^k	Special wind region ^l		Windborne debris zone ^m	Weathering ^a				
—	—	—	—	—	—	—	—	—	—	—
MANUAL J DESIGN CRITERIAⁿ										
Elevation			Altitude correction factor ^e	Coincident wet bulb	Indoor winter design relative humidity	Indoor winter design dry-bulb temperature	Outdoor winter design dry-bulb temperature		Heating temperature difference	
—	—	—	—	—	—	—	—	—	—	—
Latitude			Daily range	Summer design gains	Indoor summer design relative humidity	Indoor summer design dry-bulb temperature	Outdoor summer design dry-bulb temperature		Cooling temperature difference	
—	—	—	—	—	—	—	—	—	—	—

For SI: 1 pound per square foot = 0.0479 kPa, 1 mile per hour = 0.447 m/s.


- a. Where weathering requires a higher strength concrete or grade of masonry than necessary to satisfy the structural requirements of this code, the frost line depth strength required for weathering shall govern. The weathering column shall be filled in with the weathering index, "negligible," "moderate" or "severe" for concrete as determined from Figure R301.2(1). The grade of masonry units shall be determined from ASTM C34, ASTM C55, ASTM C62, ASTM C73, ASTM C90, ASTM C129, ASTM C145, ASTM C216 or ASTM C652.
- b. Where the frost line depth requires deeper footings than indicated in Figure R403.1(1), the frost line depth strength required for weathering shall govern. The jurisdiction shall fill in the frost line depth column with the minimum depth of footing below finish grade.
- c. The jurisdiction shall fill in this part of the table to indicate the need for protection depending on whether there has been a history of local subterranean termite damage.
- d. The jurisdiction shall fill in this part of the table with the wind speed from the basic wind speed map [Figure R301.2(2)]. Wind exposure category shall be determined on a site-specific basis in accordance with Section R301.2.1.4.
- e. The jurisdiction shall fill in this section of the table to establish the design criteria using Table 10A from ACCA Manual J or established criteria determined by the jurisdiction.
- f. The jurisdiction shall fill in this part of the table with the seismic design category determined from Section R301.2.2.1.
- g. The jurisdiction shall fill in this part of the table with: the date of the jurisdiction's entry into the National Flood Insurance Program (date of adoption of the first code or ordinance for management of flood hazard areas); and the title and date of the currently effective Flood Insurance Study or other flood hazard study and maps adopted by the authority having jurisdiction, as amended
- h. In accordance with Sections R905.1.2, R905.4.3.1, R905.5.3.1, R905.6.3.1, R905.7.3.1, R905.8.3.1, and R905.8.3.1, where there has been a history of local damage from the effects of ice damming, the jurisdiction shall fill in this part of the table with "YES." Otherwise, the jurisdiction shall fill in this part of the table with "NO."
- i. The jurisdiction shall fill in this part of the table with the 100-year return period air freezing index (BF-days) from Figure R403.3(2) or from the 100-year (99 percent) value on the National Climatic Data Center data table "Air Freezing Index-USA Method (Base 32°F)."
- j. The jurisdiction shall fill in this part of the table with the mean annual temperature from the National Climatic Data Center data table "Air Freezing Index-USA Method (Base 32°F)."
- k. In accordance with Section R301.2.1.5, where there is local historical data documenting structural damage to buildings due to topographic wind speed-up effects, the jurisdiction shall fill in this part of the table with "YES." Otherwise, the jurisdiction shall indicate "NO" in this part of the table.
- l. In accordance with Figure R301.2(2), where there is local historical data documenting unusual wind conditions, the jurisdiction shall fill in this part of the table with "YES" and identify any specific requirements. Otherwise, the jurisdiction shall indicate "NO" in this part of the table.
- m. In accordance with Section R301.2.1.2 the jurisdiction shall indicate the wind-borne debris wind zone(s). Otherwise, the jurisdiction shall indicate "NO" in this part of the table.
- n. The jurisdiction shall fill in these sections of the table to establish the design criteria using Table 1a or 1b from ACCA Manual J or established criteria determined by the jurisdiction.
- o. The jurisdiction shall fill in this section of the table using the Ground Snow Loads in Figures R301.2(3) and R301.2(4).

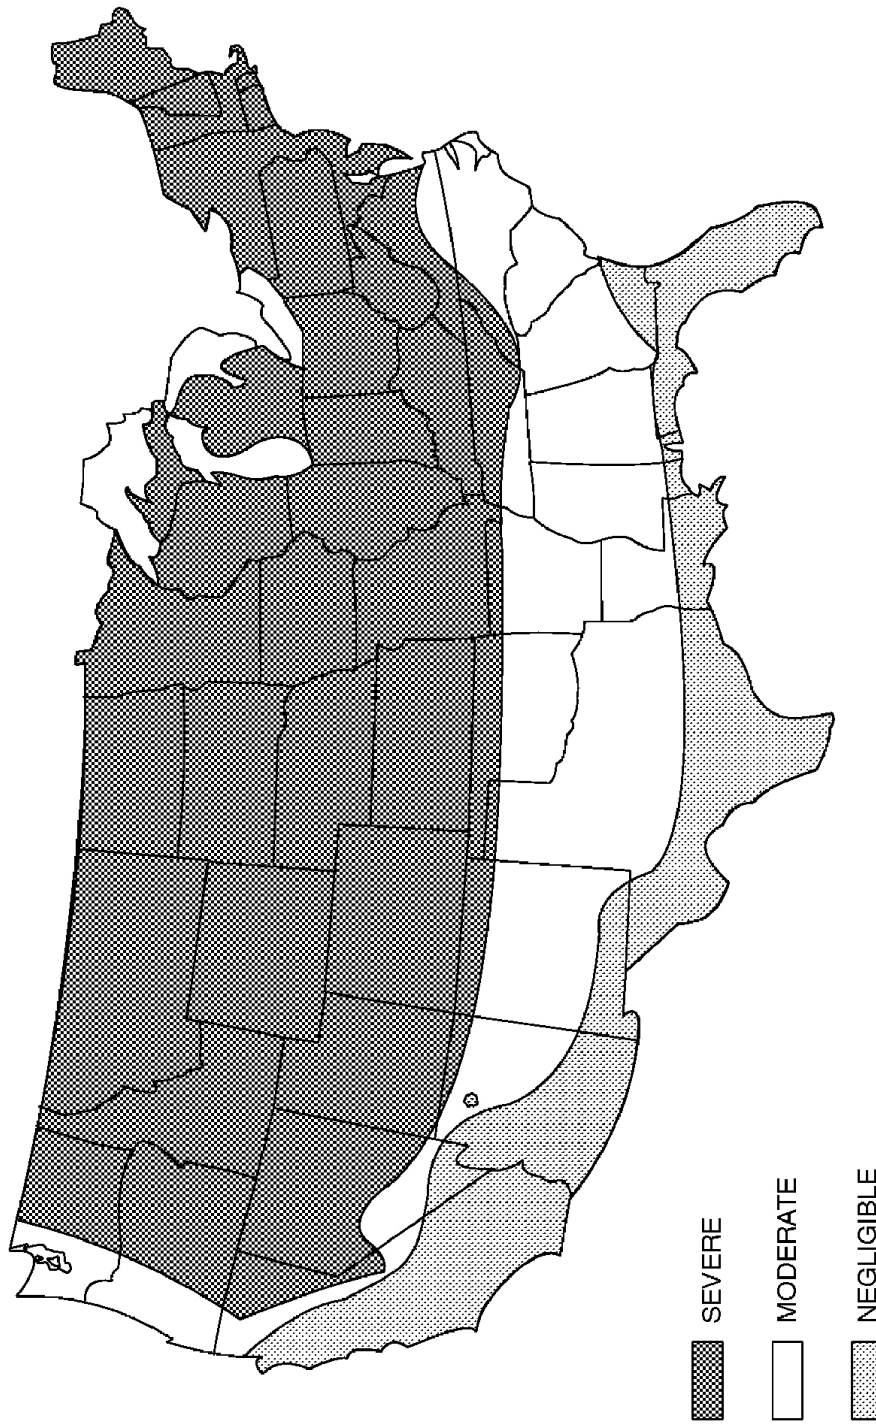

a. Alaska and Hawaii are classified as severe and negligible, respectively.

b. Lines defining areas are approximate only. Local conditions may be more or less severe than indicated by region classification. A severe classification is where weather conditions result in significant snow-fall combined with extended periods during which there is little or no natural thawing, causing deicing salts to be used extensively.

**FIGURE R301.2(1)
WEATHERING PROBABILITY MAP FOR CONCRETE^{a,b}**

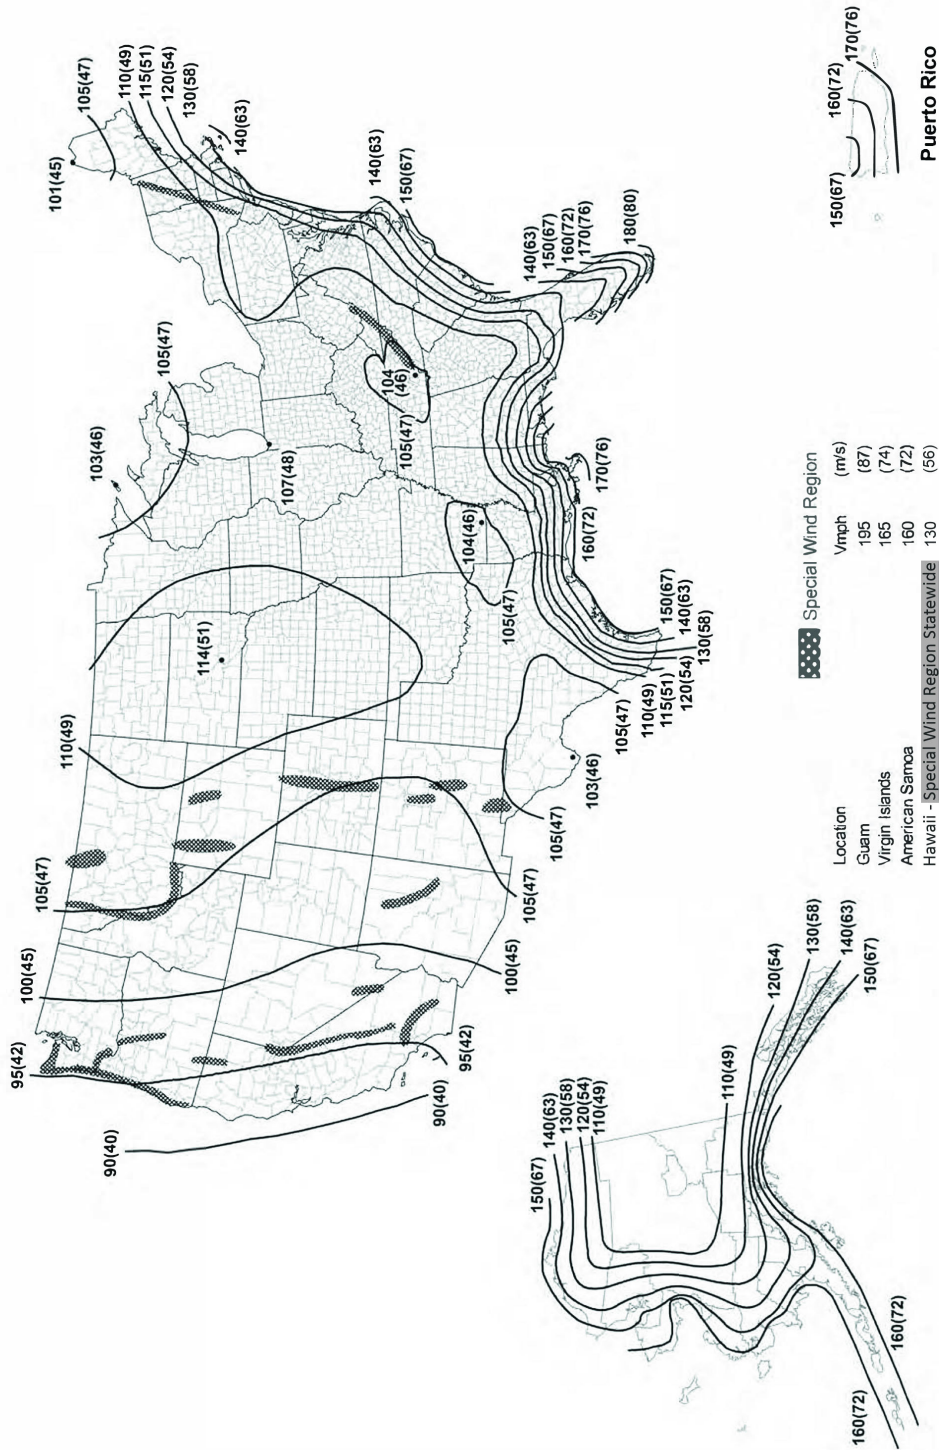

- Notes:
1. Values are nominal design 3-second gust wind speeds in miles per hour (m/s) at 33 ft (10m) above ground for Exposure C category.
 2. Linear interpolation is permitted between contours. Point values are provided to aid with interpolation.
 3. Islands, coastal areas, and land boundaries outside the last contour shall use the last wind speed contour.
 4. Mountainous terrain, gorges, ocean promontories, and special wind regions shall be examined for unusual wind conditions.
 5. Wind speeds correspond to approximately a 7% probability of exceedance in 50 years (Annual Exceedance Probability = 0.00143, MRI = 700 Years).
 6. Location-specific basic wind speeds shall be determined using www.atcouncil.org/windspeed

FIGURE R301.2(2)
ULTIMATE DESIGN WIND SPEEDS

**TABLE R301.2(1)
GROUND SNOW LOADS FOR SELECTED LOCATIONS IN UTAH**

CITY/TOWN	COUNTY	GROUND SNOW LOAD (lb/ft ²)	ELEVATION (ft)
Beaver	Beaver	35	5,886
Brigham City	Box Elder	42	4,423
Castle Dale	Emery	32	5,669
Coalville	Summit	57	5,581
Duchesne	Duchesne	39	5,508
Farmington	Davis	35	4,318
Fillmore	Millard	30	5,138
Heber City	Wasatch	60	5,604
Junction	Piute	27	6,030
Kanab	Kane	25	4,964
Loa	Wayne	37	7,060
Logan	Cache	43	4,531
Manila	Daggett	26	6,368
Manti	Sanpete	37	5,620
Moab	Grand	21	4,029
Monticello	San Juan	67	7,064
Morgan	Morgan	52	5,062
Nephi	Juab	39	5,131
Ogden	Weber	37	4,334
Panguitch	Garfield	41	6,630
Parowan	Iron	32	6,007
Price	Carbon	31	5,558
Provo	Utah	31	4,541
Randolph	Rich	50	6,286
Richfield	Sevier	27	5,338
St. George	Washington	21	2,585
Salt Lake City	Salt Lake	28	4,239
Tooele	Tooele	35	5,029
Vernal	Uintah	39	5,384

Note: To convert lb/ft² to kN/m², multiply by 0.0479. To convert feet to meters, multiply by 0.3048.

1. Statutory requirements of the authority having jurisdiction are not included in this state ground snow load table.
2. For locations where there is substantial change in altitude over the city/town, the load applies at and below the cited elevation, with a tolerance of 100 ft (30 m).
3. For other locations in Utah, see Bean, B., Maguire, M., Sun, Y. (2018), "The Utah Snow Load Study," Utah State University Civil and Environmental Engineering Faculty Publications, Paper 3589, <http://utahsnowload.usu.edu/>, for ground snow load values.